



# HITACHI

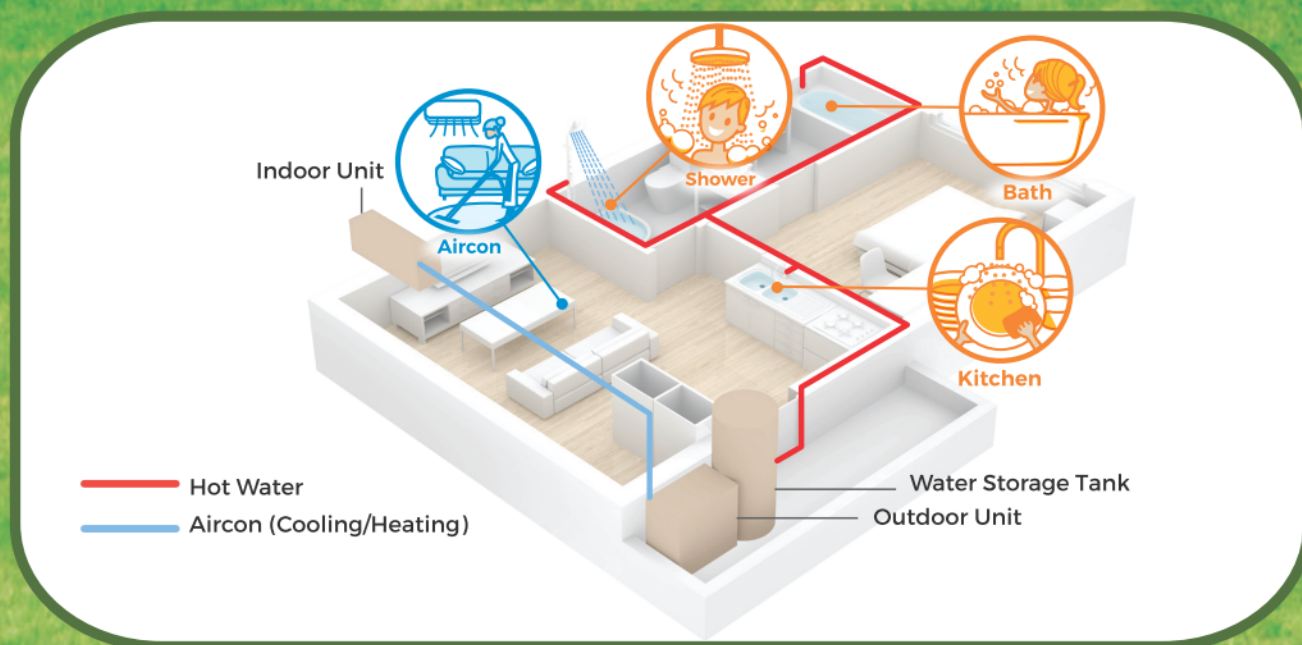


## HEAT RECYCLE PROCESS

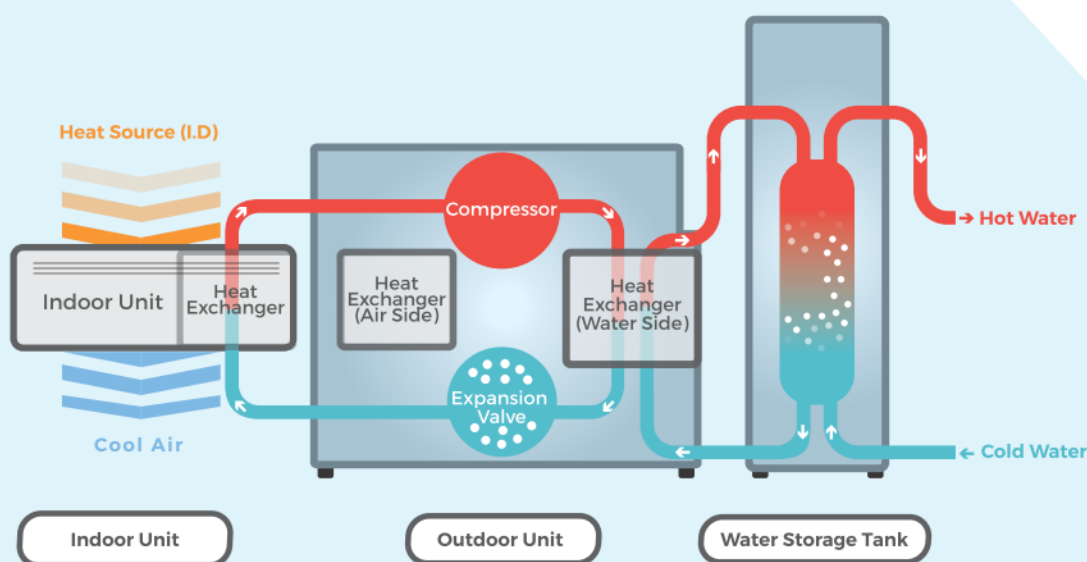

When indoor unit is running, you get free cost for your water heating

## GENERAL ORDINARY HEATING PROCESS

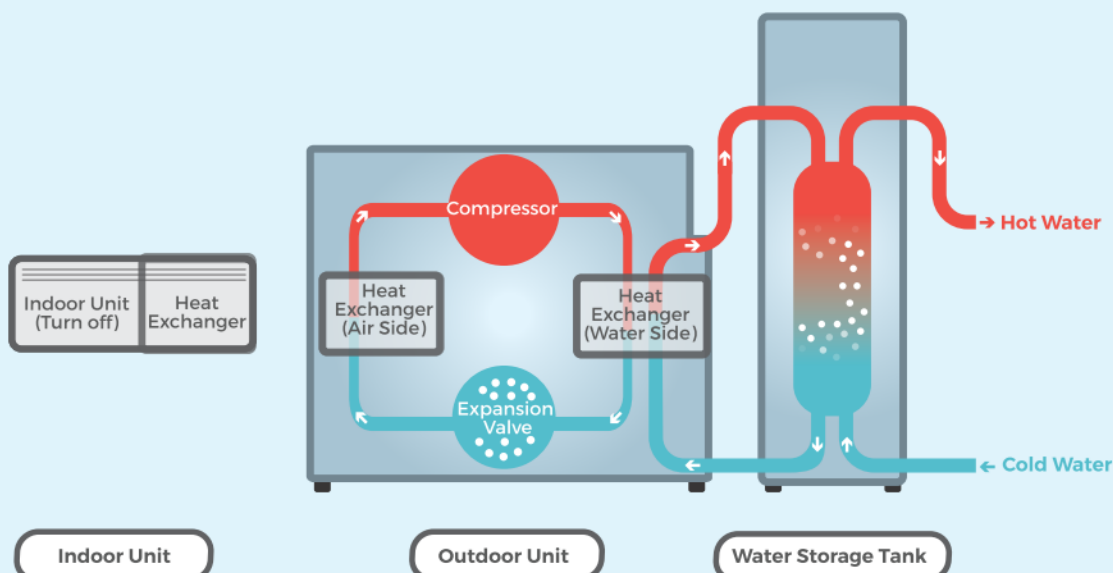

Equipment	Energy (water) Demand per Day		
	5,600kcal	11,200kcal	16,800kcal
	Cost		
Inverter Composite Air Conditioner	14	29	43
Electric Heater	71	142	214
Daily Difference	57	114	170
Yearly Difference	20,730	41,460	62,191

Note:

\* Assume daily use is 70 liters/persons, total energy demand per person is 2,800 kcal/h

\*\*Water inlet is 15°C and Water outlet is 55°C

\*\*\*kW/h rate is P9.84